

Project/Location: _____

Contractor: _____

Date: _____

Prepared by: _____

HZ Series

Combination Unit for Hazardous Locations:
 Class I Zone 2 Groups: IIA, IIB and IIC
 Class I Division 2 Groups: A, B, C and D



Typical Specification

Supply and install Ready-Lite **HZ Series** combination of unit equipment and LED exit sign. Designed specifically for hazardous locations, the equipment frame shall be of industrial grade polymer with gaskets around both sides of the frame contour. The back plate shall be made of 1/8-inch thick aluminum sheet and shall include knockouts for installation on an electrical box and four keyholes for alternative installation on a wall surface.

The faceplate shall be constructed of heavy-duty vandal-resistant polycarbonate and feature a uniformly illuminated legend. The light source shall be light emitting diodes (LED). Red LED technology shall be **AllnGap**. An LED-sensitive diffuser shall be mounted behind the legend to provide the 6" high by 3/4" stroke letters with even illumination.


When specified, the equipment shall have attached a lower compartment containing two emergency lights with adjustable swivels and long-life MR-16 halogen lamps of ___ V and ___ W. The lamps shall be shielded by cast aluminum housing and protected by a shock-absorbent, transparent polycarbonate cover.

The equipment shall be certified for Hazardous Locations; Class I Zone 2 Groups: IIA, IIB and IIC and Class I Division 2 Groups: A, B, C and D. The standard AC input voltage shall be: 120/347Vac. The equipment shall be equipped with a magnetic test switch located behind the face plate and two LED pilot lights: AC-on and "Service required". The unit shall include self-testing/self-diagnostic functions monitored by a micro-controller and shall automatically self test for one minute every 30 days, 10 minutes in the 6th month and 30 minutes annually. The "Service required" LED shall light when a fault is detected. A four-LED diagnostic display located inside the equipment shall identify the source of the failure (battery, charger circuitry, or lamp load).

The exit sign module shall be CSA-C860 approved.

The combination unit shall be Ready-Lite model: _____.

Dimensions

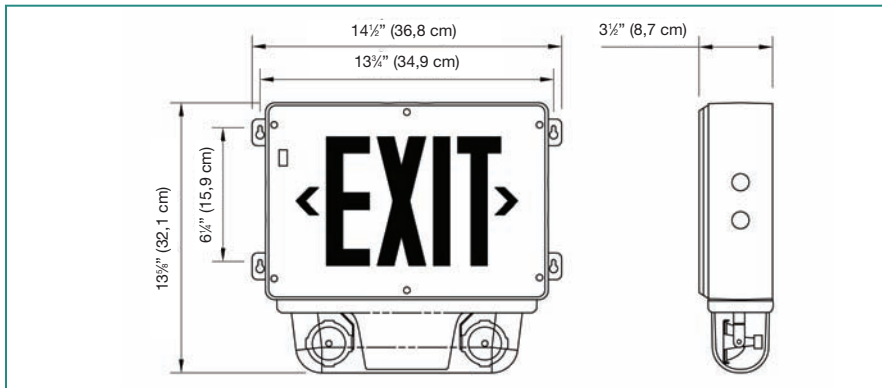

Power Consumption

Model Number	AC Specs	Wattage Capacity					
		30min	1h00	1h30	2h00	4h00	
HZ36	120 / 347Vac	0.15 / 0.06 Amp	36	21	15	12	-
HZ36N		0.15 / 0.06 Amp	36	30	20	15	-
H12260		0.30 / 0.10 Amp	60	40	30	20	10

Ordering Information

Series	Number of Heads	Lamp/Wattage	Housing/Faceplate Colour	AC Voltage	Letter Colour	Options
HZ36 = 6V - 36W lead acid HZ36N = 6V - 36W NiCad H12260 = 12V - 60W NiCad	Blank = no heads 2 = 2 heads	MJ = MR16, 6V - 10W MK = MR16, 12V - 12W MW = MR16, 12V - 20W H LD7 = 12V - 4W LED	GG = grey/grey	Blank = 120/347Vac U2 = 120/277Vac	Blank = Red letters G = Green letters	AD = self-diagnostics, audible ADN = self-diagnostics, non-audible (standard) NEX = Nexus® System interface* *Consult your sales representative for options available with NEXUS® System.

EXAMPLE: HZ362MJGGAD

Features

- Certified Class I Zone 2, Groups IIA, IIB and IIC
- Certified Class I Division 2, Groups A, B, C and D as per CSA C22.2 No.137-M1981
- Certified temperature Codes for several types of emergency lamps
- Certified CSA C22.2 No141
- Certified CSA C860
- Polymeric frame, with built-in gasket to prevent water infiltration
- Heavy-duty 1/8-inch thick aluminum back plate with key-holes for secure wall-mount installation
- Sealed faceplate of heavy-duty, vandal-resistant polycarbonate
- Suited for areas with the risk flammable gases, vapors or liquids that can create an explosive atmosphere
- Exit sign module illuminated by long-life, energy-efficient **AllnGap** red LEDs
- Two MR16 halogen lamps, shielded by a cast aluminum housing and a polycarbonate cover
- Sealed, maintenance-free, Lead-Calcium or Nickel-Cadmium batteries
- Remote load capacity
- Comes standard with self-test/self-diagnostic functions
- Comes standard with industrial-grade, die-cast Aluminum electrical box
- 1/2-inch electrical conduit entry on both sides and at the top
- NEXUS® compatible (for more information on NEXUS®, please contact your sales representative)



Wire Guards

460.0080-RL Wall Mount

Temperature Codes

Lamp Rating	Temperature Code	Maximum Temperature	Replacement Part #
6V - 10W	T3C	160 °C	580.0079-RL
12V - 12W	T3A	180 °C	580.0080-RL
12V - 20W-H	T2D	215 °C	580.0068-RL

Note: Use qualified replacement lamps to avoid risk of over-heating